




Ford Wasbaugh Double Lid Cover W4-TT

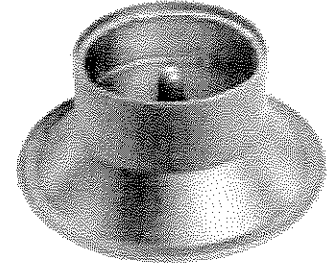

Townhouse and Duplex water service lines for water mains installed before Jan. 01, 2010 and with permission from the Sprinkler Company. Pressure should be above 90psi at curb.

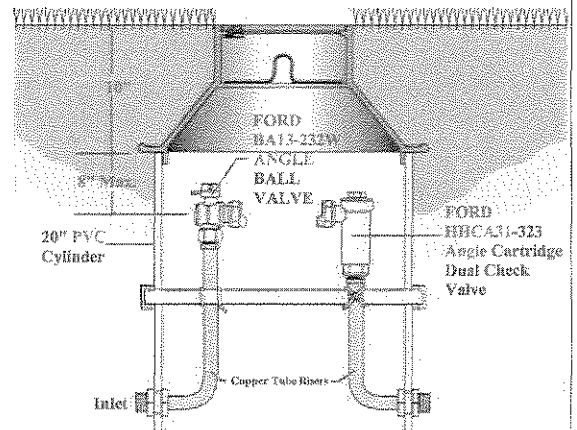

Meter Pit and Setter Detail

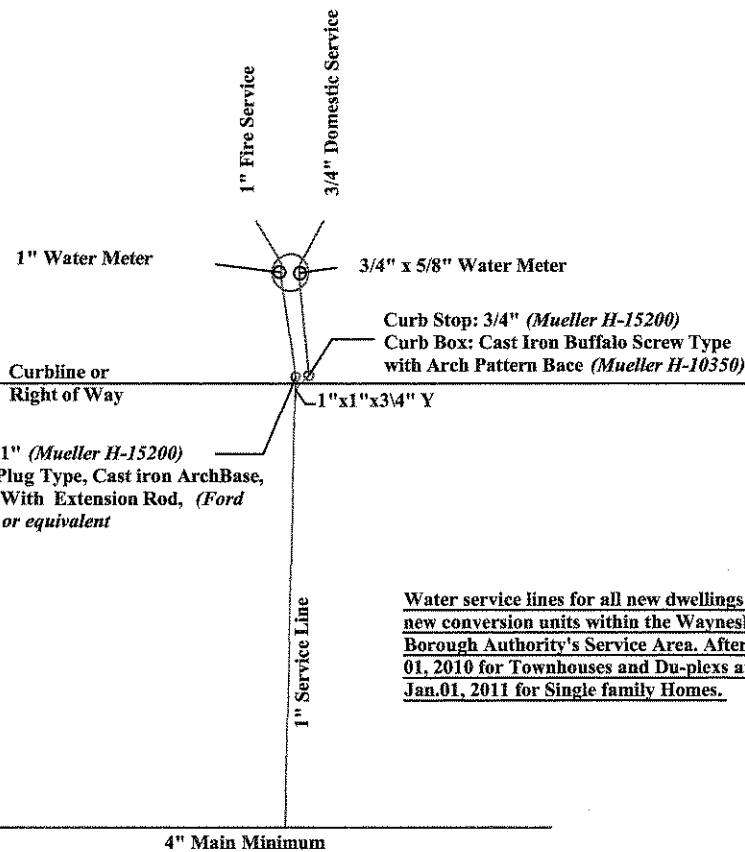

Water service lines for all new dwellings and new conversion units within the Waynesboro Borough Authority's Service Area. After Jan. 01, 2010 for Townhouses and Du-plex and Jan.01, 2011 for Single family Homes.

APPROVED THIS 20<sup>th</sup>  
DAY OF July 2010

*Jon Fleagle*  
JON FLEAGLE, CHAIRMAN

**BOROUGH OF WAYNESBORO**  
**RESIDENTIAL SPRINKLER SYSTEM**  
**SERVICE LINES**

REVISIONS	SCALE	DESIGNER	DRAWN BY:
1. Changed to add comments from the Authority June 16, 2010	N.T.S.	HDG	SAC
	DATE	FIELD BOOK REF:	CHECKED BY:
	JUNE 7, 2010		HDG